Top View

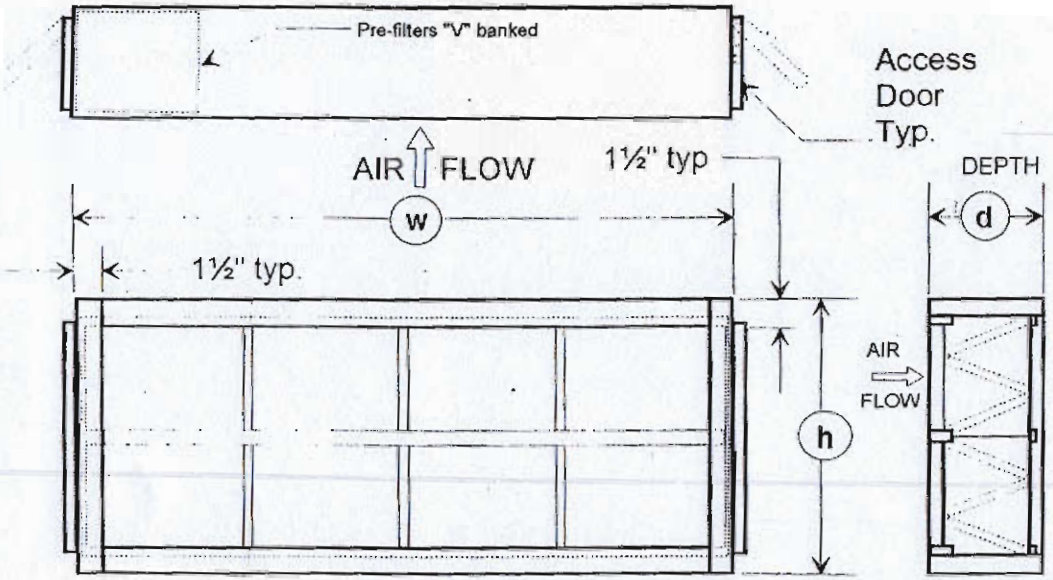

Front View

Side View

Filter Schedule				
Qty	Size	Model	Eff %	P.Drop

NOTES:

1. Housings are factory assembled and manufactured from 16 gauge welded galvanized steel
2. Filter tracks are made from galvanized steel
3. Housing Weight: _____ lbs. (less filter)
4. Housing Depth : ☐ 30" inches ☐ _____

TAG:

Options:

☐ Stainless Steel body ☐ Painted
☐ Insulated ☐ Other: _____
☐ Aluminum body _____
☐ Dwyer 200___-AF gage

Width Code (# of filters)	1	1½	2	2½	3	3½	4	4½	5	5½	6	6½	7	
Width Inches (W)	23⅜	34¾	46¾	58⅜	70⅛	81½	93½	104⅞	116⅞	128⅜	140¼	151⅝	163⅝	

Height Code	Height Inches (H)
½	15
1	27
1½	39
2	51
2½	63
3	75
3½	87
4	99

"V" Bank Filter Housing Code

Side Access Housing
SUBMITTAL

Model "V"

APPLIED AIR FILTERS
San Jose, CA
TEL (408) 441-8000
FAX (408) 441-1245

Project:

HVAC Mechanical

6/96